

FFRDC/FNLCR

Managed Facilities

Buildings













438

432













Animal Facilities

















Transjector 5246


Nikon

ZEISS

CAUTION
THIS UNIT MAY
EXPLODE IF
FLAMMABLE GAS
IN THIS UNIT





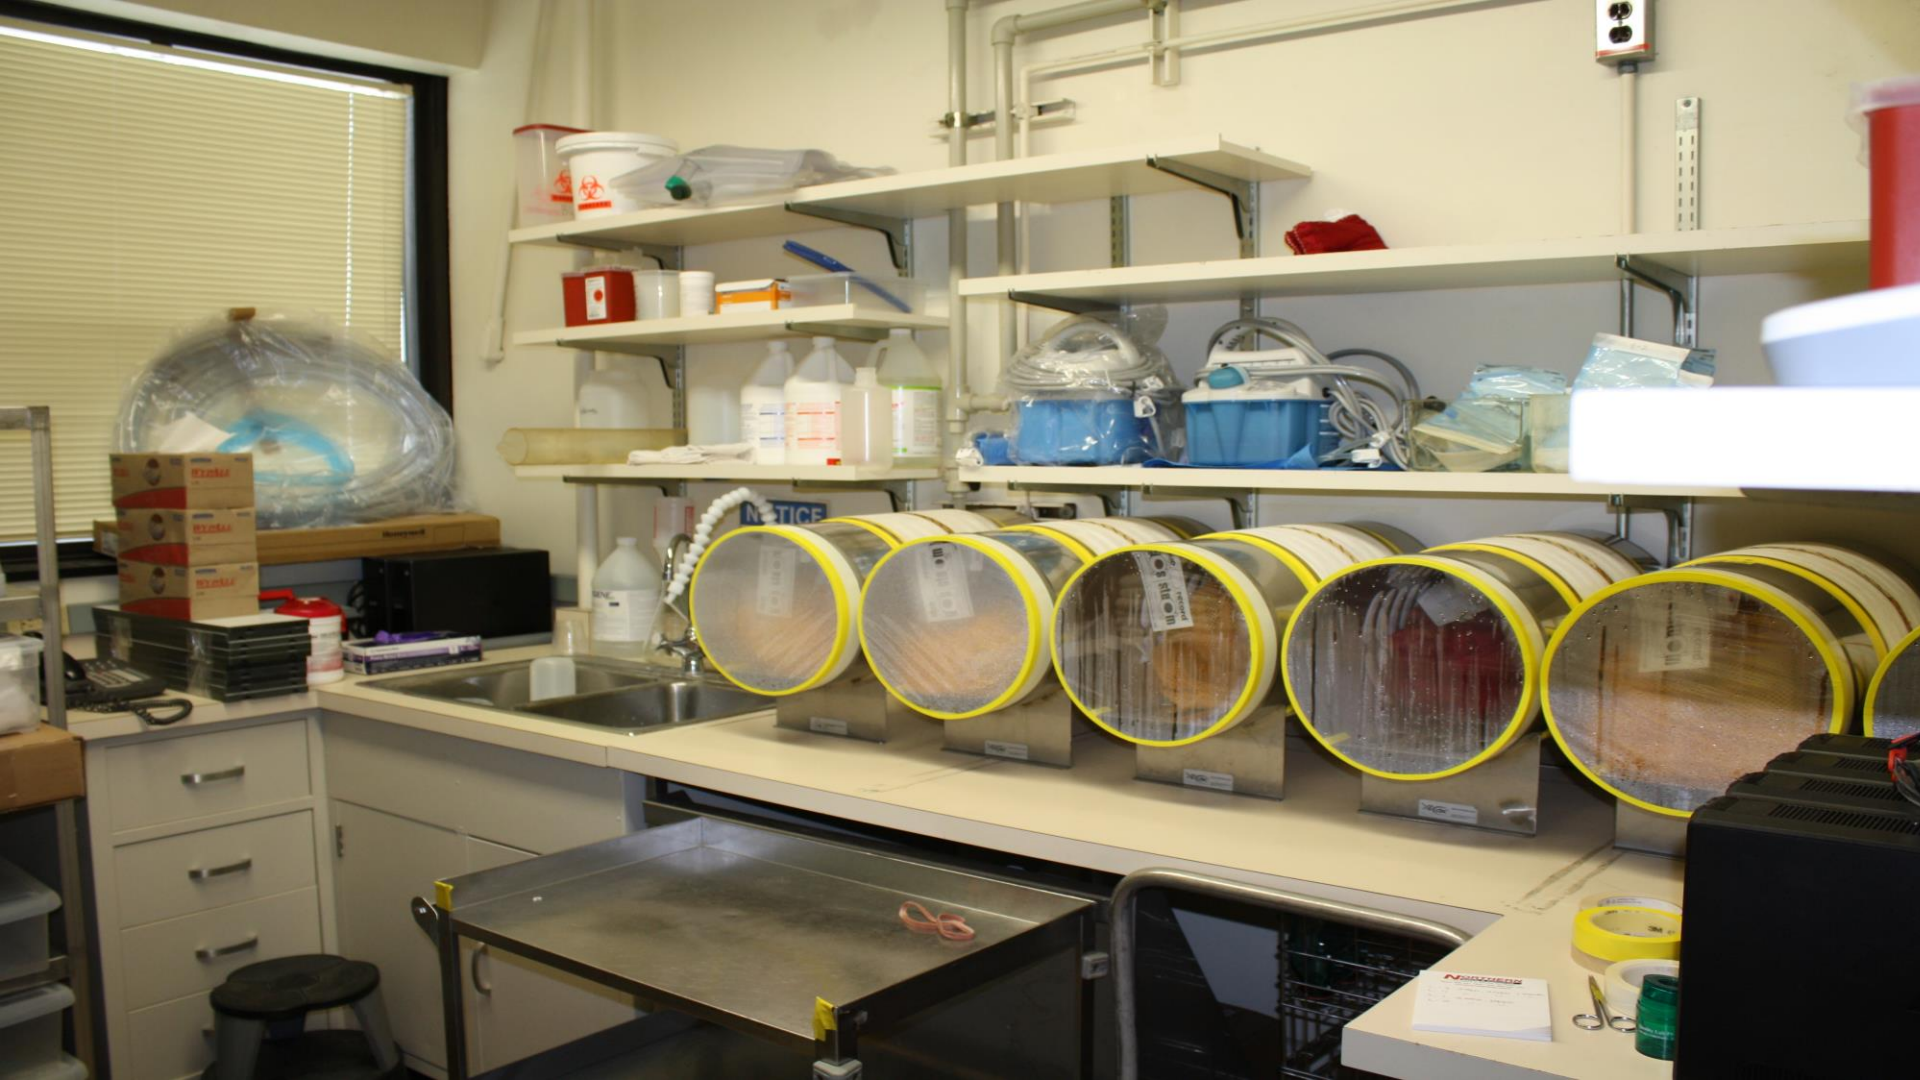





FLOW SCIENCES, INC.

FLAMMABLE
KEEP FIRE AWAY










XENOGEN

T

TIV SPECTRUM

XGI-8

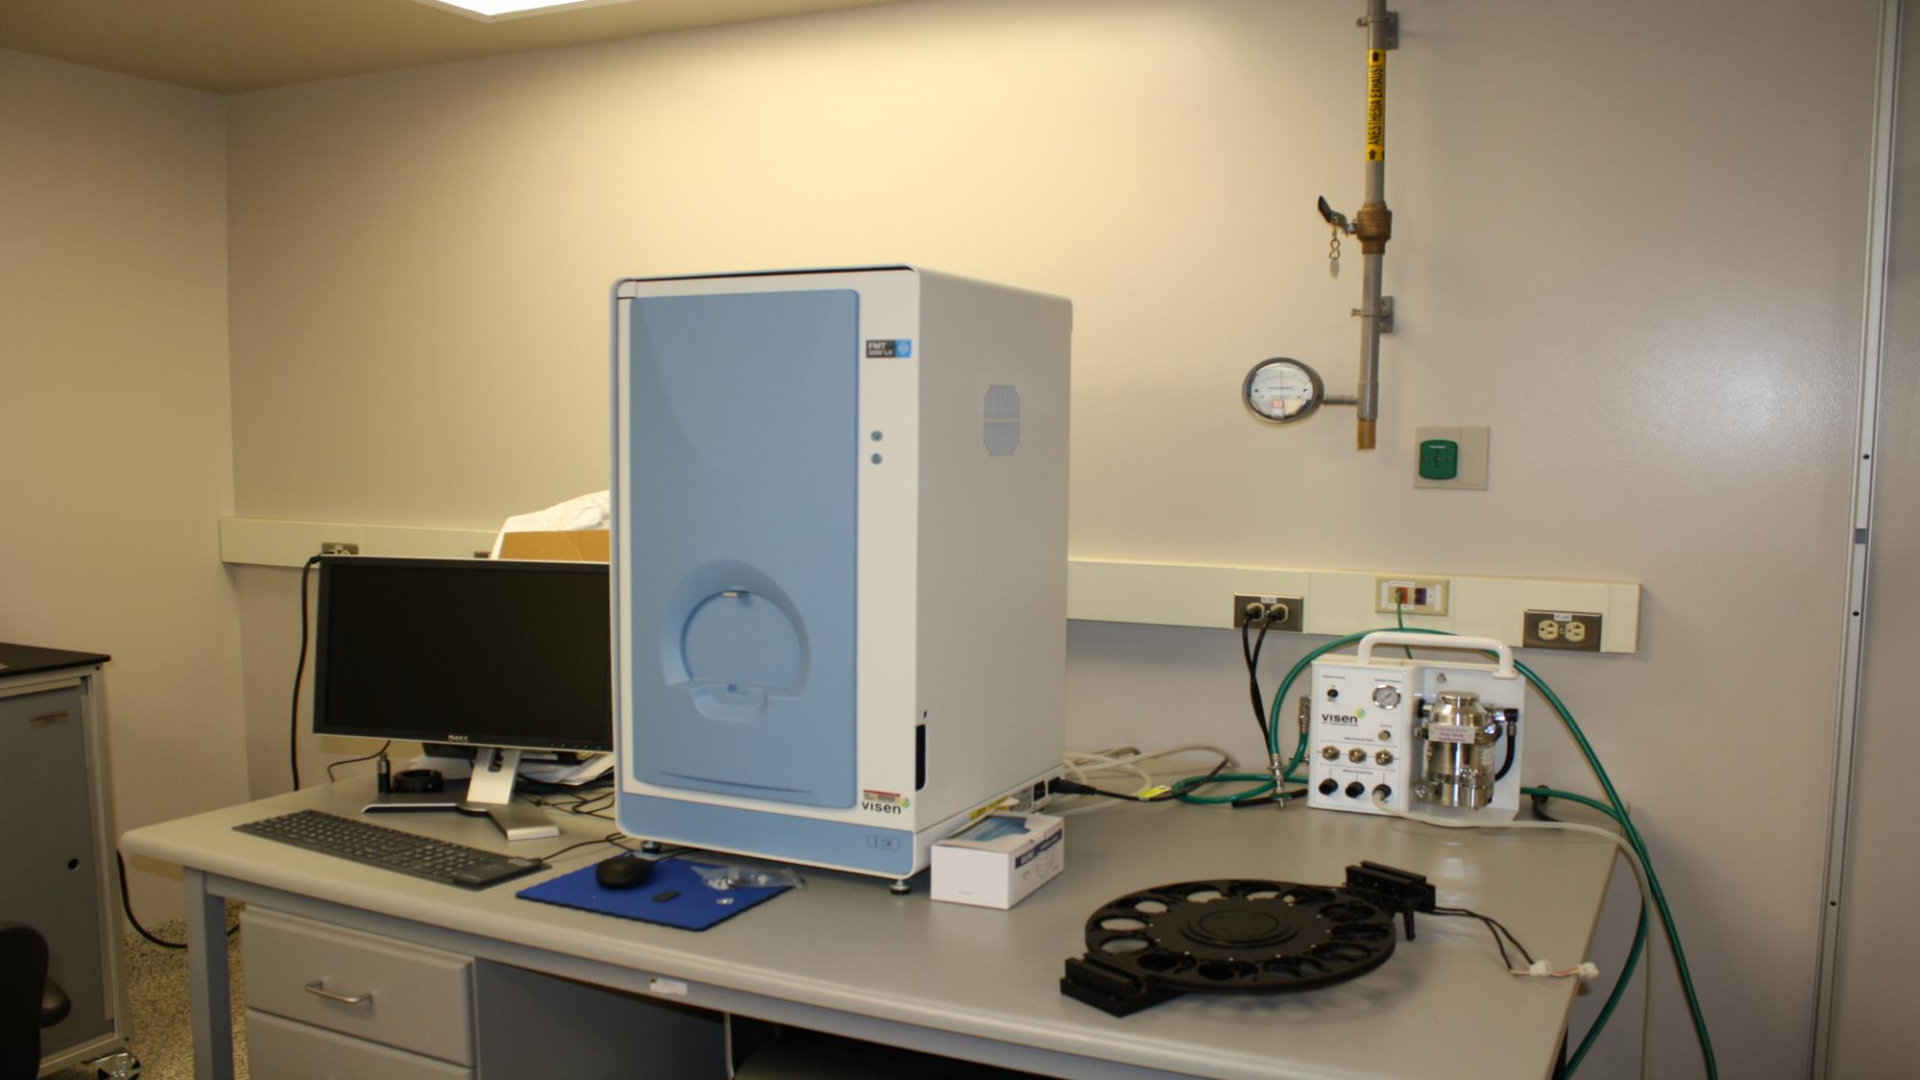

















MADE IN USA
BY
THOREN
HAZLETON, PA















SYSTEM ON

STOP
EMERGENCY







Edstrom
QUICK CONNECT SYSTEM
24V POWER SUPPLY

Edstrom

STATUS: ARMED, NO ALARM, 12:00 PM, 12/15/2010

SERVICE POWER ALARM

SILENCE

F1	ABC 1	DEF 2	GHI 3
F2	JKL 4	MNO 5	PQR 6
F3	STU 7	VWX 8	YZ 9
ESC	/	0	* /

ENTER

0007-7195-8301

0007-7195-8701









cGMP Facilities





Biorepository Facilities





Laboratories





































EMERGEN



Eye wash station
Keep area clear





FLAMMABLE
KEEP FIRE AWAY

FLAMMABLE
KEEP FIRE AWAY

























Puffer
Hubbard



U-48

EXIT





EXIT

11-28



CLASS II TYPE B1











IF ALARM IS ACTIVATED
PLEASE EXIT BUILDING
LOW PROFILE & LEAVE.
CALL SECURITY (212-606-6000)

Canon



Infrastructure









EXHAUST







Facilities and Maintenance

Craft Shops















Guifil

PE 30-150

WARNING

WARNING

Administrative Space















Frederick
National
Laboratory
for Cancer Research









27
K
Room







NATIONAL[®]
CANCER
INSTITUTE



**NATIONAL
CANCER
INSTITUTE**

www.cancer.gov

www.cancer.gov/espanol